




# UNDERGROUND SERVICE ENTRANCE Structures Only

Phone: 817.444.3201 ★ [tcectexas.com](http://tcectexas.com)

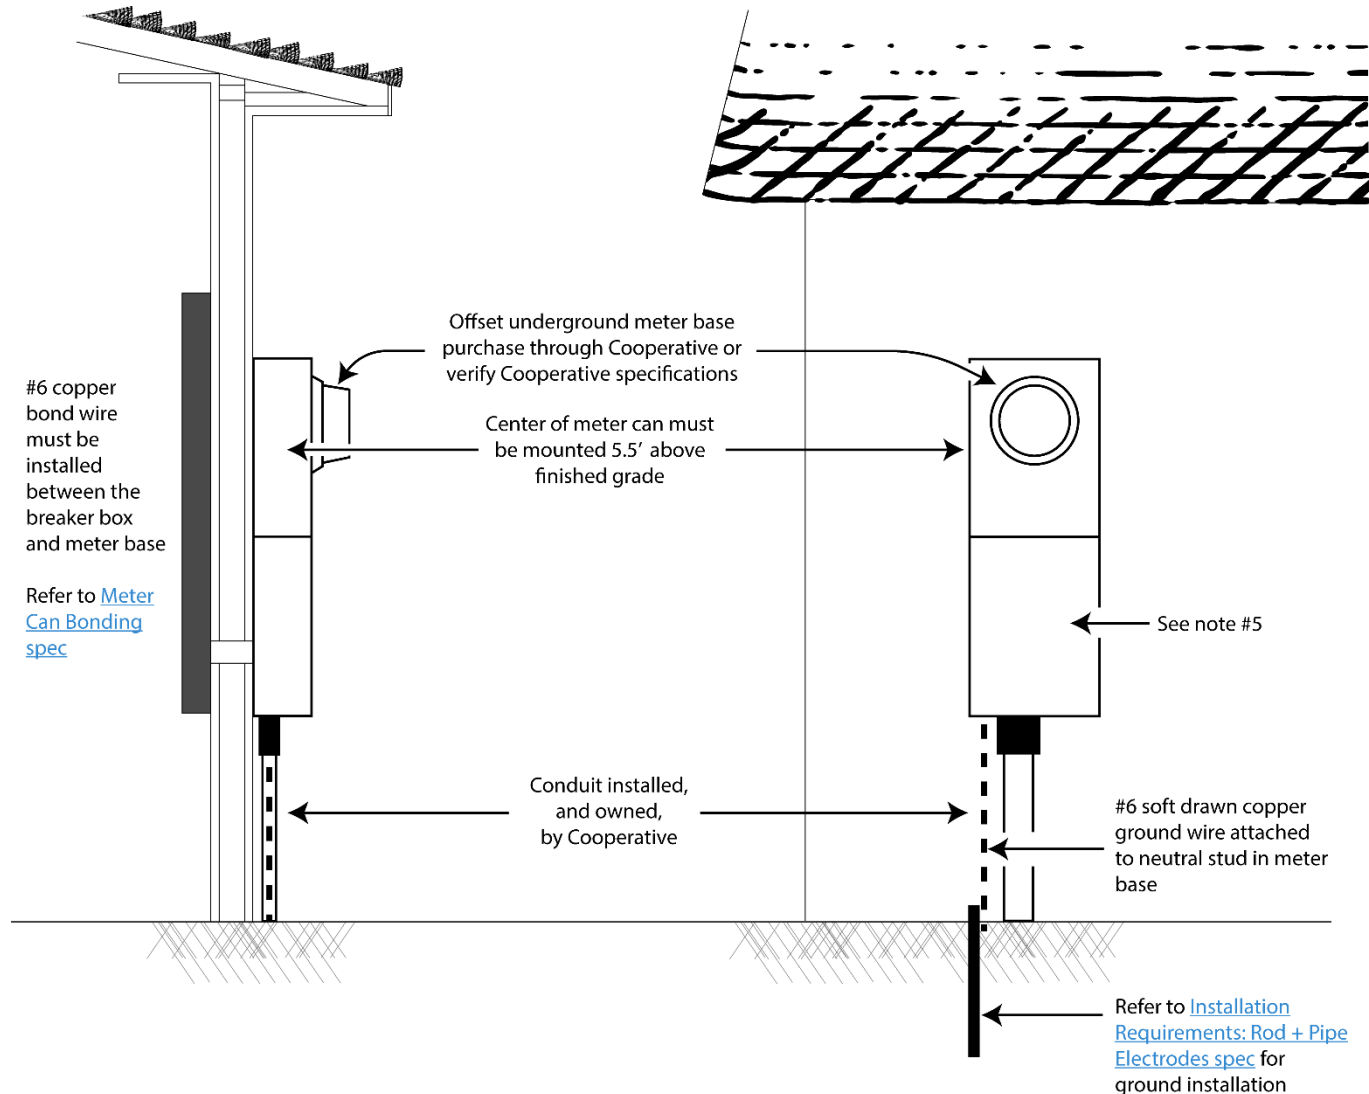

## NOTES:

1. Meter sockets must conform to specifications furnished by Tri-County Electric Cooperative and mounted approximately 5.5' above finished grade. Meter socket must be a minimum of 200 AMP offset meter base.
2. Customer installation must comply within National Electric Code and applicable city ordinance.
3. Proper copper wire size must be used in meter loop. Main disconnect cannot have a rating larger than the meter base.
  - a. 100 AMP service: #2 copper or 2/0 aluminum, both line and neutral
  - b. 200 AMP service: 2/0 copper or 4/0 aluminum, both line and neutral
  - c. 320 AMP service: 350 MCM copper or 500 MCM aluminum, both line and neutral
4. New construction not receiving a meter 10 days after construction is complete will be billed the minimum charge based on applicable rate schedule.
5. Service Disconnect must be exterior and within 3' of meter.
6. Not available for non-permanent structure.