
Gang Meter Base



Rack of 6



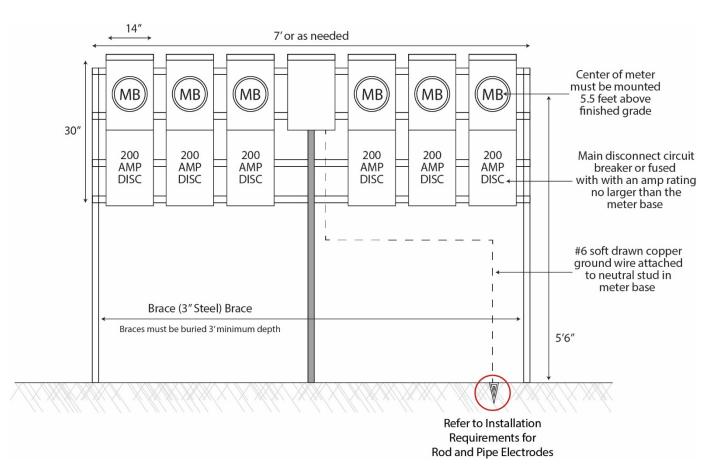

- 1. Meter sockets must conform to specifications furnished by Tri-County Electric Cooperative and mounted approximately 5.5 ft. above finished grade.
- 2. Member installation must comply with National Electric Code and applicable city ordinance.
- 3. Proper copper wire size must be used in meter loop. Main disconnect can not have rating larger than the meter base.

a. 200 Amp service: 2/0 (00) Copper both line and neutral (residential only)

- 4. New construction not receiving a meter 10 days after construction is complete, will be billed the minimum charge based on the applicable rate schedule.
- 5. If a request is made to connect service and the meter loop fails to meet requirements, the Cooperative will not connect service and will bill the account for applicable trip charge.
- 6. Raceway or tap can must be rated sufficiently for the connected load.