




A Touchstone Energy® Cooperative

Phone: 817.444.3201 ★ tcectexas.com

UNDERGROUND SERVICE ENTRANCE Structures Only

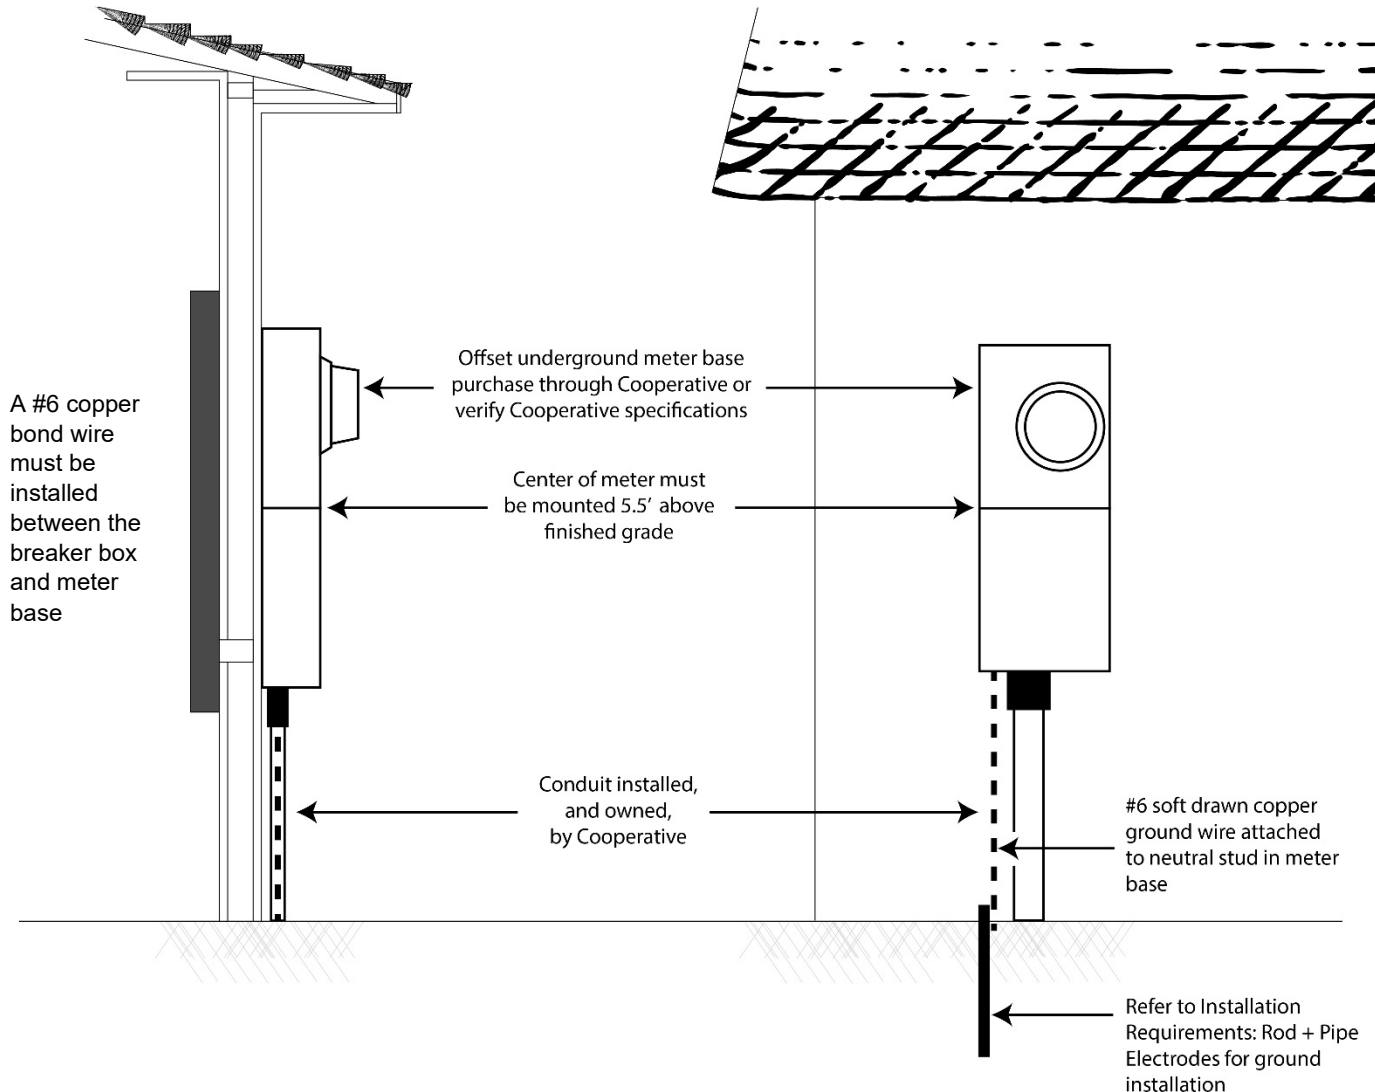

NOTES:

1. Meter sockets must conform to specifications furnished by Tri-County Electric Cooperative and mounted approximately 5.5' above finished grade. Meter socket must be a minimum of 200 AMP offset meter base.
2. Member installation must comply within National Electric Code and applicable city ordinance.
3. Proper copper wire size must be used in meter loop. Main disconnect cannot have a rating larger than the meter base.
 - a. 100 AMP service: #2 copper both line and neutral
 - b. 200 AMP service: 2/0 (00) copper both line and neutral
 - c. 320 AMP service: 350 MCM copper both line and neutral
4. New construction not receiving a meter 10 days after construction is complete will be billed the minimum charge based on applicable rate schedule.
5. If a request is made to connect service and the meter loop fails to meet requirements, the Cooperative will not connect service and will bill the account applicable trip charge.